


1. Collect, feed and refill

96 x 120 in clear room; 36 in usable front doorway centred at x=48; door opens outward. The example carries a 24 x 22 in loaded water container, including its handles.

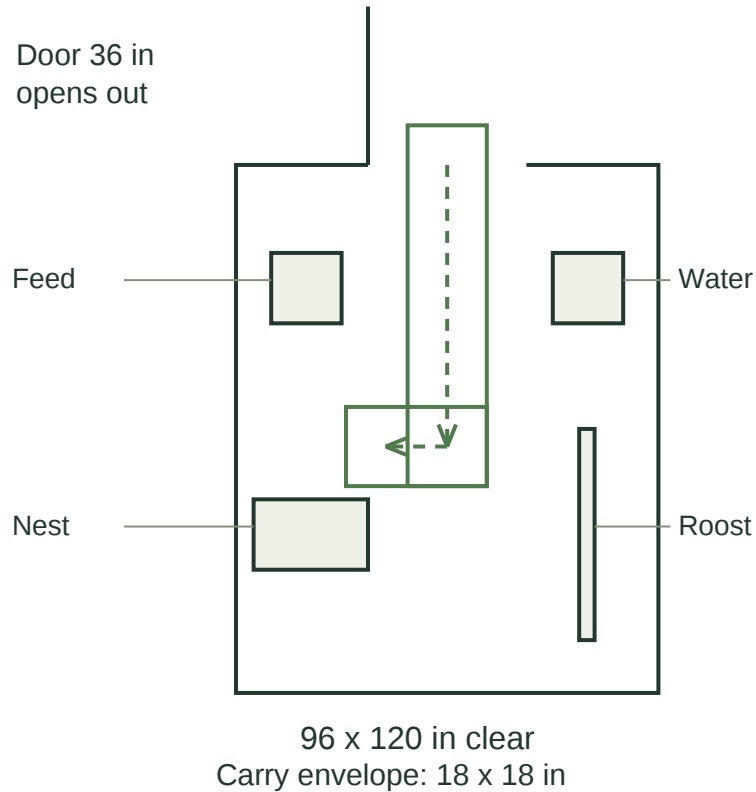


Enter along the centre lane. Stop beside each supply without standing in its footprint. Collect from the front of the nest unit; inspect beneath the side roost. These stops do not establish reach height or bird access.

The specified fixed-orientation water-container route clears the illustrated furniture and doorway in plan. The complete physical carry and the outward door landing remain field checks.

2. Close and prepare the water container

96 x 120 in clear room; 36 in usable front doorway centred at x=48; door opens outward. The example carries a 24 x 22 in loaded water container, including its handles.

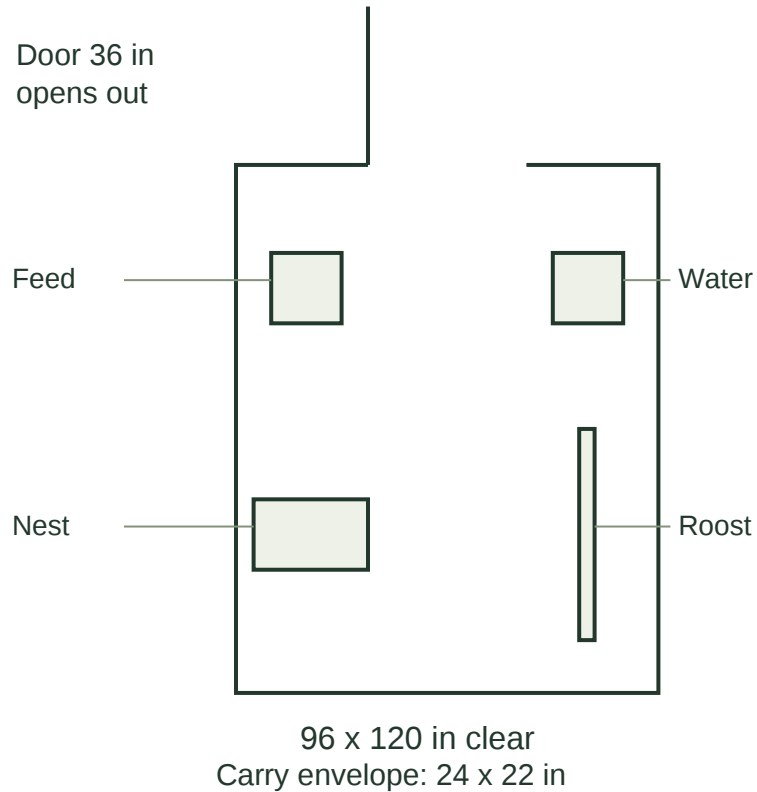


Secure birds away from the operation. Close the container and release its actual mounting. The 24 x 22 in envelope includes protruding handles; check its full weight and grasp before lifting.

The specified fixed-orientation water-container route clears the illustrated furniture and doorway in plan. The complete physical carry and the outward door landing remain field checks.

3. Move sideways, then through the door

96 x 120 in clear room; 36 in usable front doorway centred at x=48; door opens outward. The example carries a 24 x 22 in loaded water container, including its handles.

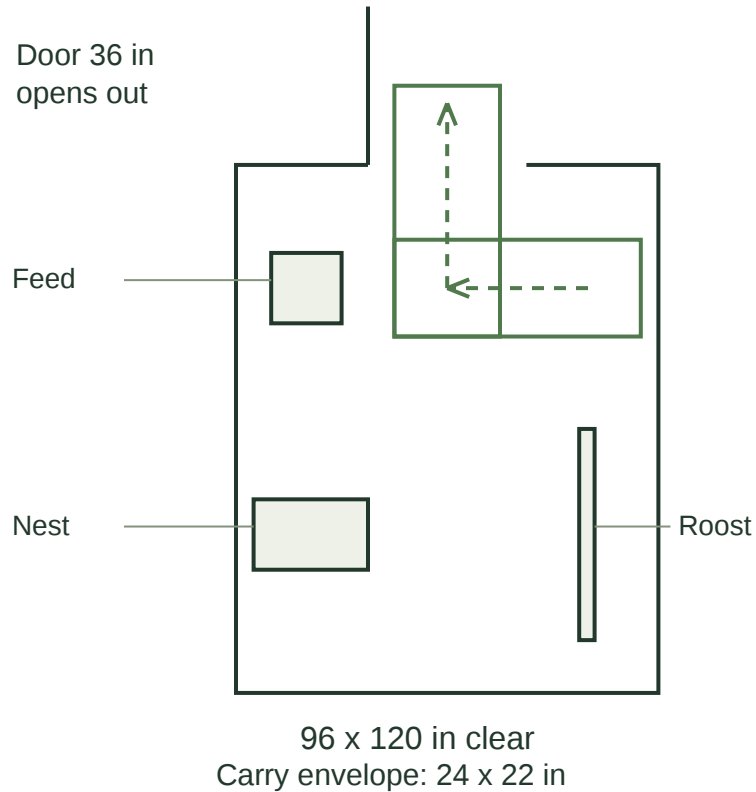


Move the water container from (80,28) to the centre of the room at (48,28), then straight out. Keep it in the same orientation. The door must already be held fully open, with the exterior landing clear.

The specified fixed-orientation water-container route clears the illustrated furniture and doorway in plan. The complete physical carry and the outward door landing remain field checks.

4. Remove the local spill and inspect

96 x 120 in clear room; 36 in usable front doorway centred at x=48; door opens outward. The example carries a 24 x 22 in loaded water container, including its handles.

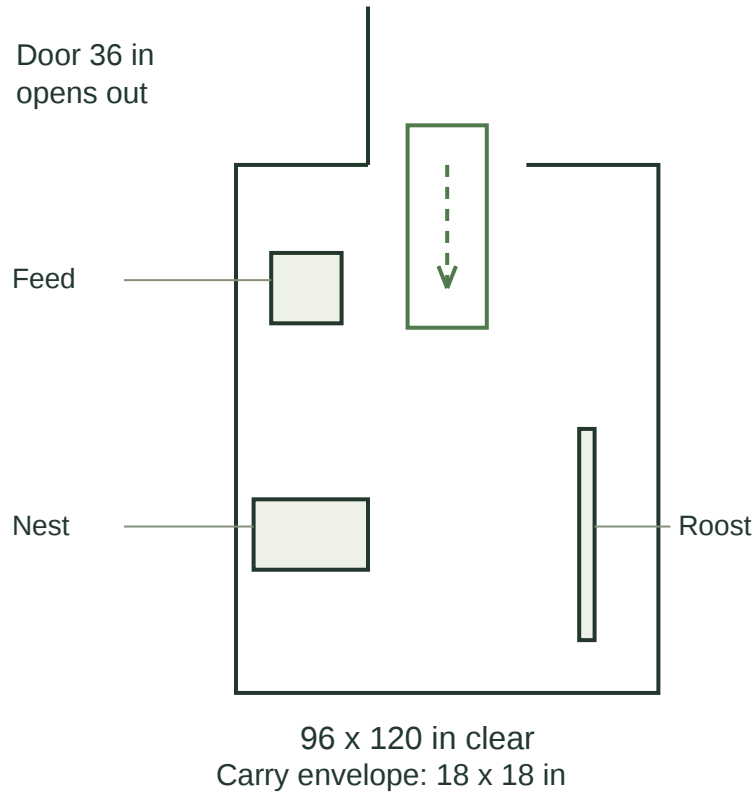


With the waterer outside, remove wet bedding and inspect the exposed base and seams. Use the floor-appropriate method; this local operation does not clear the whole room or permit hosing a wood assembly.

The specified fixed-orientation water-container route clears the illustrated furniture and doorway in plan. The complete physical carry and the outward door landing remain field checks.

5. Dry, return and secure

96 x 120 in clear room; 36 in usable front doorway centred at x=48; door opens outward. The example carries a 24 x 22 in loaded water container, including its handles.

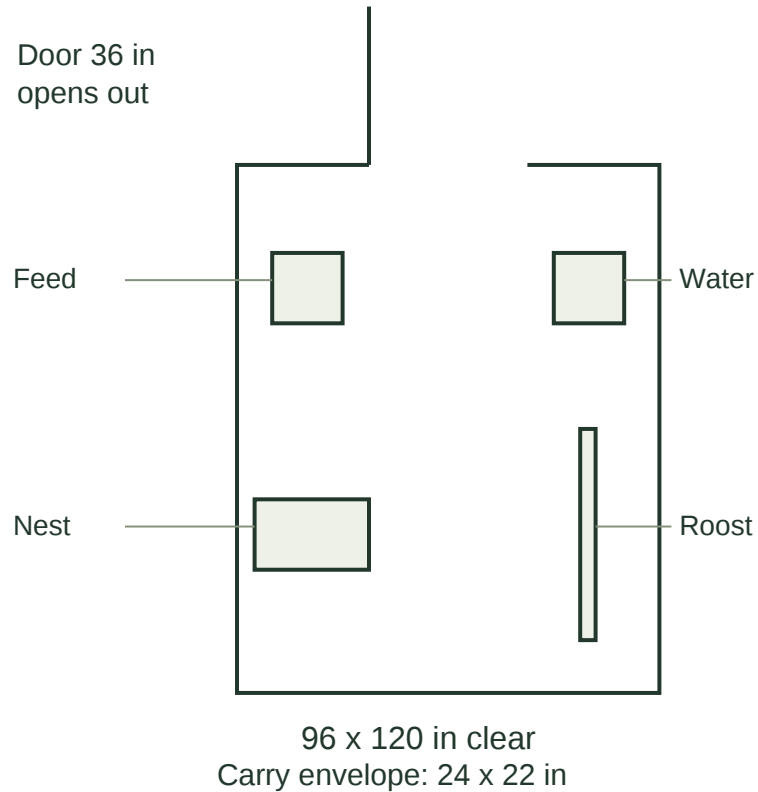

After the surface and container are ready, reverse the same route, refit the mount and check supply access and leaks. Record recurring moisture before restoring bedding.

The specified fixed-orientation water-container route clears the illustrated furniture and doorway in plan. The complete physical carry and the outward door landing remain field checks.